



Washington State Patrol
Fire Protection Bureau
Phone: (360) 596-3900

Business Name Summit Place Assisted Living
Address 2905 CONNELLY AVE ,
City, State, Zip Bellingham, WA 98225

Provider Number 001606
Approval Status Approved
Facility Type Residential Care

On 08/23/2023 the Office of the State Fire Marshal conducted an inspection at your facility.

All violations noted during previous related inspection(s) have been corrected.

Owner or Owner's Representative


Signature

Elizabeth Martin Executive Director
Print Name and Title

Deputy State Fire Marshal Brandon G. Brown
16778 146 ST SE
Monroe WA 98272
(360) 791-7037


Signature

This document was prepared by Residential Care Services for the Locator website.

Right of appeal. Any person may appeal any decision made by the Fire Protection Bureau in accordance with WAC 212-12.



Washington State Patrol
Fire Protection Bureau
Phone: (360) 596-3900

Business Name Summit Place Assisted Living
Address 2905 CONNELLY AVE,
City, State, Zip Bellingham, WA 98225

Provider Number 001606
Approval Status Disapproved
Facility Type Residential Care

On 08/14/2023 the Office of the State Fire Marshal conducted an inspection at your facility.

Code Requirement

Statement of Violation

1 Unapproved conditions

Open junction boxes and open-wiring splices shall be prohibited. Approved covers shall be provided for all switch and electrical outlet boxes.

(IFC 604.6, 2018)

The following violation was observed:

There was an electrical outlet without a faceplate in the kitchen hallway, exposing the inner electrical fixture.

2 Power Test

Battery-powered emergency lighting equipment shall be tested annually by operating the equipment on battery power for not less than 90 minutes.

(IFC 1031.10.2 2018)

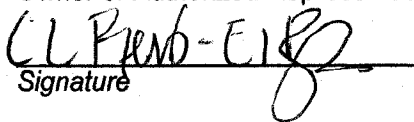
The following violation was observed:

Facility is unable to provide documentation for the annual 90 minute power test for the emergency lights.

Next inspection scheduled on or after: 09/13/2023

Right of appeal. Any person may appeal any decision made by the Fire Protection Bureau in accordance with WAC 212-12.

Owner or Authorized Representative


Signature

Catherine Preis-Elbarn Administrator
Print Name and Title

Deputy State Fire Marshal Brandon G. Brown
16778 146 ST SE
Monroe WA 98272
(360) 791-7037


Signature