



Business Name	Meridian at Stone Creek (The)	Provider Number	2365
Address	1111 S 376th ST ,	Approval Status	Approved
City, State, Zip	Milton, WA 98354	Facility Type	Residential Care

On 09/04/2024 the Office of the State Fire Marshal conducted an inspection at your facility.

Code Requirement	Statement of Violation
------------------	------------------------

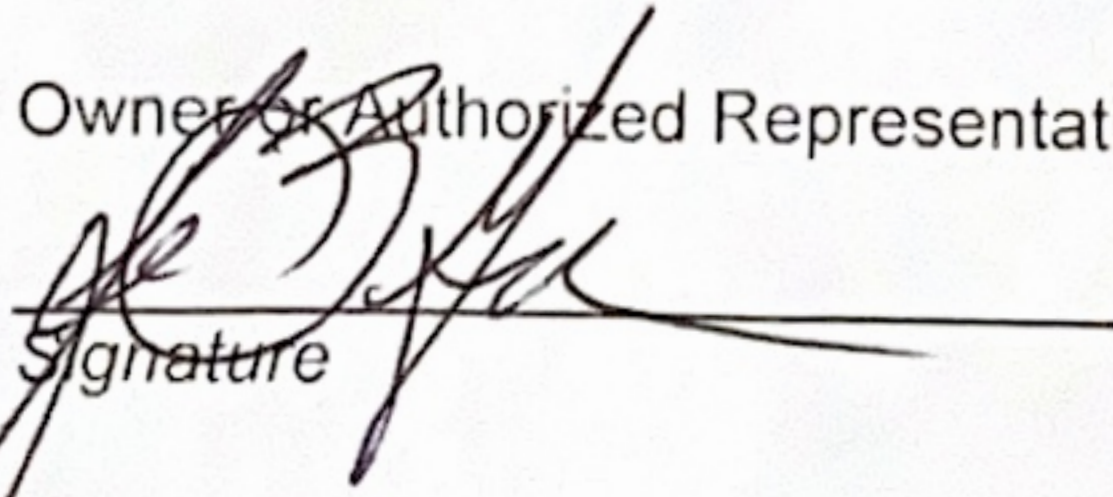
1 Admin Complaint

COMPLAINT # 143353 Here's a complaint of kitchen fire Please include the answers to the following questions in your report in FDM. 1. The cause of the fire? 2. If the sprinklers were activated? 3. If there was an evacuation / how many were evacuated? 4. If there were injuries / how many? 5. Did the fire department respond? Yes, No	On 9/4/24, a complaint investigation was conducted for complaint ID# 143353 at The Meridian at Stone Creek, in Milton, WA. The complaint was in regards to a small kitchen fire that occurred within the oven located in the facility's kitchen. An interview was conducted with facility maintenance director. According to the interview, staff witnessed a small fire within the oven and it quickly was extinguished. No kitchen suppression system or fire sprinkler system activation occurred, resulting in no need for resident evacuations and no injuries reported. The incident required no fire department response. No violations were observed with the facility response to the incident, and no IFC violations were detected.
--	---

Next inspection scheduled on or after:

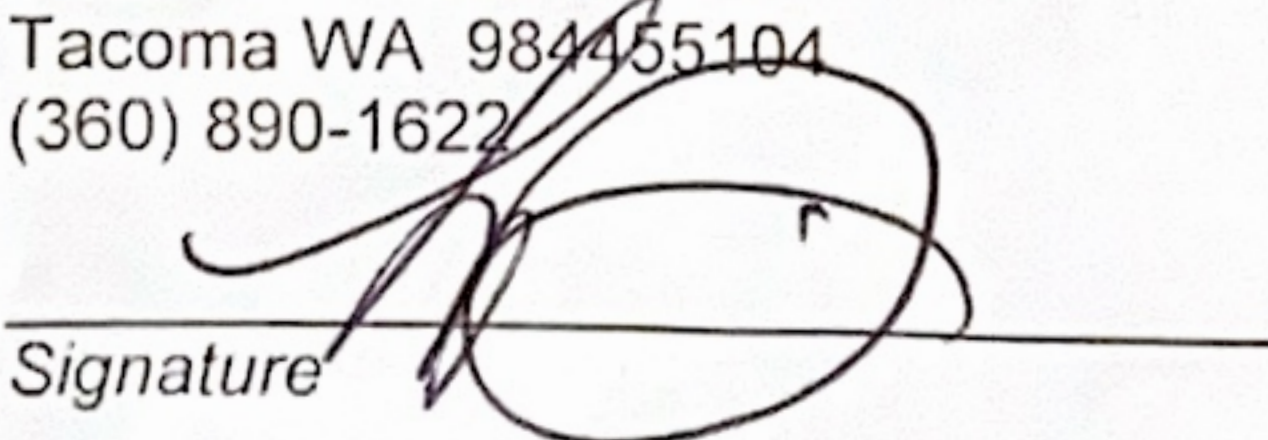
Right of appeal. Any person may appeal any decision made by the Fire Protection Bureau in accordance with WAC 212-12.

Owner or Authorized Representative


Signature

George B. Gae Maintenance Director
Print Name and Title

Deputy State Fire Marshal Lysandra Davis
2502 112 ST
Tacoma WA 984455104
(360) 890-1622


Signature